



September 1, 2014

REPORT TO: THE MAYOR AND COUNCIL

**RE: Street Lighting Recommendation
September 2014**

Dear Mayor and Members of Council:

Submitted to you herewith is a request for street lighting improvements which is ready for your approval. A copy of the recommendation of the City of Vineland Electric Utility with respect to this request, along with a copy of the drawing identifying the area in question, is attached for your review.

Should you have any questions pertaining to this matter, please do not hesitate to contact this office.

Respectfully submitted,

Denise Monaco
Assistant Business Administrator

/rl
Encls.

cc: Joseph Isabella
Roxanne Tosto

Approved:

Mayor

9/9/14
Date



STREET LIGHTING RECOMMENDATION

September 2014

REQUEST

1. 1911 Dolly Drive
Drawing No. VMEU-2819

RECOMMENDATION

Upgrading of one (1) existing 70W SV street light to 100W SV street light and installation of one (1) additional 70W SV cobra head street light on existing utility pole.



MEMORANDUM

August 27, 2014

TO: DENISE MONACO, ASSISTANT BUSINESS ADMINISTRATOR
FROM: JOSEPH A. ISABELLA, DIRECTOR OF MUNICIPAL UTILITIES
SUBJECT: STREET LIGHT SURVEY

A handwritten signature in black ink, appearing to be "J. Isabella", written over the subject line.

The area mentioned below has been investigated for the possibility of installing additional street lights or for the possibility of upgrading existing street lights:

Name: Milagros Salita
Address: 1911 Dolly Drive
Vineland, NJ 08361
Telephone: 856-794-3166

The following has been recommended by the Vineland Municipal Electric Utility:


Upgrading of one (1) existing 70W SV street light to 100W SV street light and installation of one (1) additional 70W SV cobra head street light on existing utility pole.

This recommendation is illustrated on the Vineland Municipal Electric Utility Drawing No. VMEU-2819 which is attached.

JAI:djb

Attachments

VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY 08360



STREET LIGHT REQUEST

DATE: August 26, 2014

TO: John T. Boyle, Jr.

RE: Survey at : Area of 1911 Dolly Dr. NAME: Milagros Salita

ADDRESS: 1911 Dolly Drive
856-794-3166

The preceeding mentioned location must be checked to conclude the possibility of installing additional lighting. Please respond to this request in the space provided below by _____

Yours truly,

Joseph Isabella
Director

DATE: August 26, 2014


LIGHTING REQUEST IS: APPROVED: X


DISAPPROVED: _____ (if disapproved , state reason for action below)

Proposed: Upgrade one (1) existing 70w SV street light to 100w SV and install one (1) additional 70w SV cobra head street light on existing utility pole.

Yours truly,

Attachments: DWG.#VMEU-2819

Approved by : 
John T. Boyle, Jr.
Superintendent of Distribution

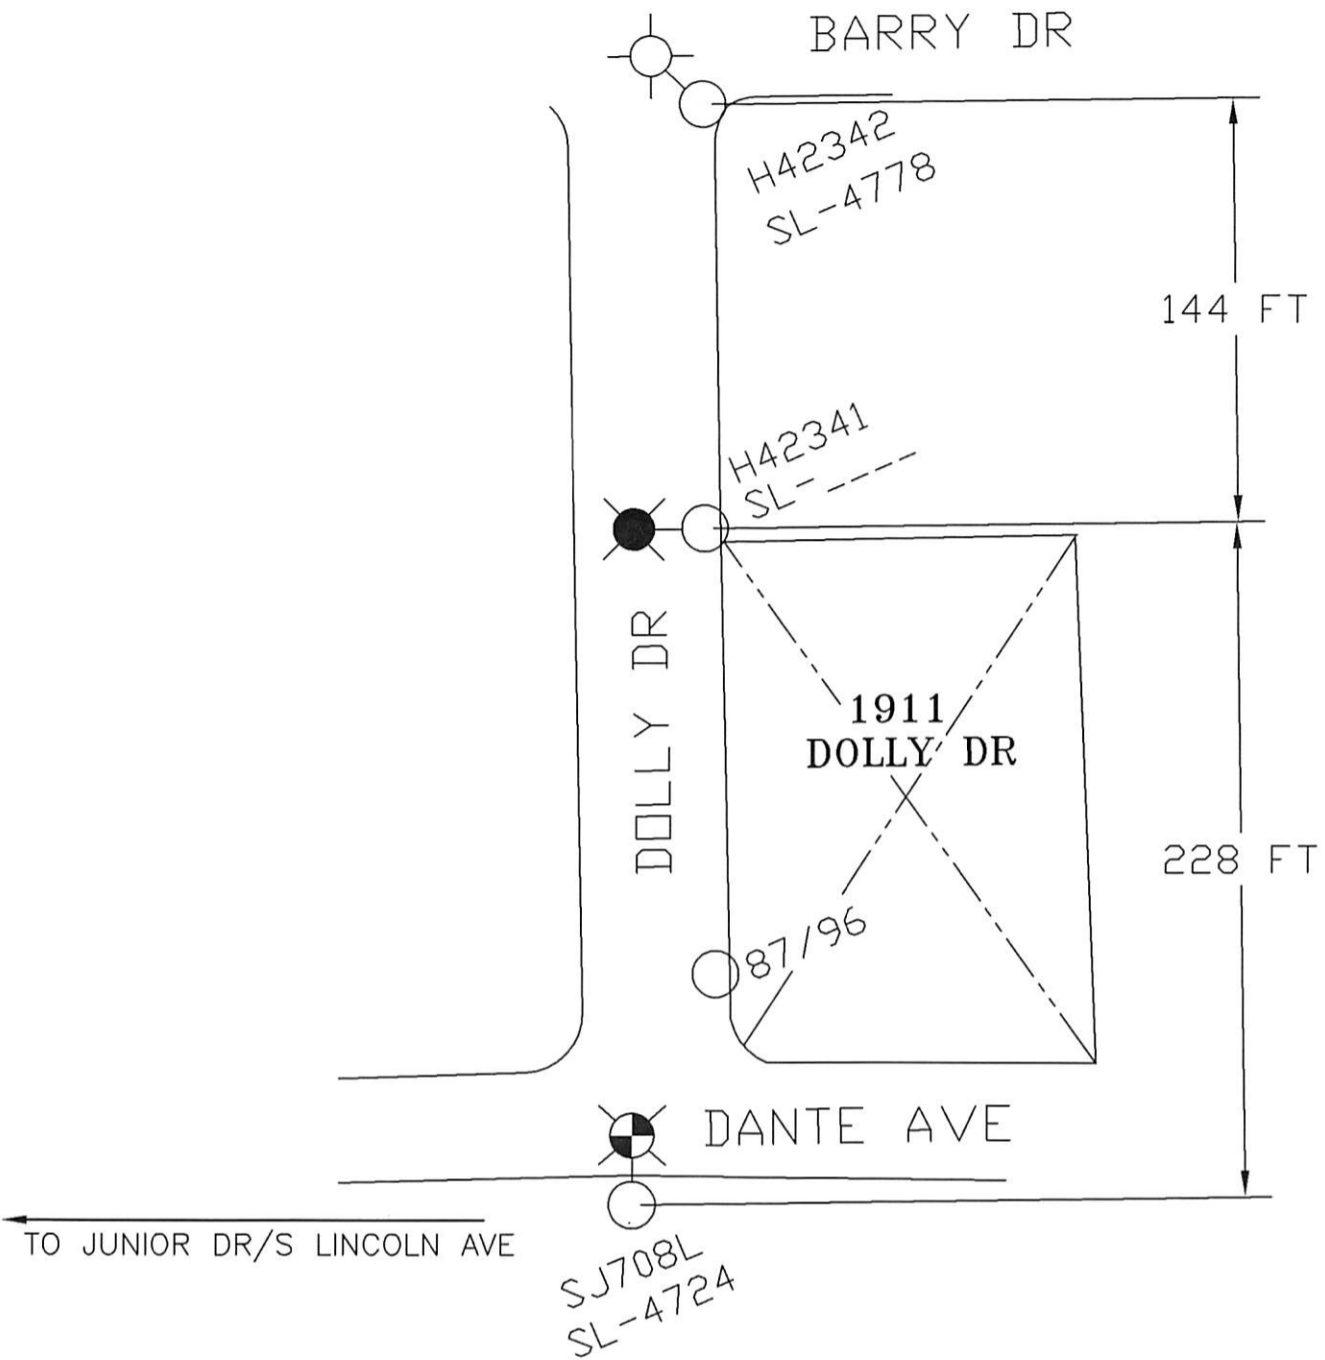

KEY:

- UPGRADE ONE (1) EXISTING 70W SV COBRA HD. ST. LT. TO 100W SV.
- INSTALL ONE (1) ADDITIONAL 70W SV COBRA HD. ST. LT. ON EXISTING UTILITY POLE.
- EXISTING ST. LT. TO REMAIN AS IS.

**PROPOSED STREET LIGHT REVISION
AREA OF 1911 DOLLY DR**

**VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY**

DRAWN: BL

VAULT # F-3-C

DATE: 8/26/2014

DRAWING # VMEU-2819

SCALE: NTS

CHECKED: