

CITY OF VINELAND

April 5, 2016

REPORT TO: THE MAYOR AND COUNCIL


**RE: Street Lighting Recommendations
April 2016**

Dear Mayor and Members of Council:

Submitted to you herewith is a request for street lighting improvements which is ready for your approval. A copy of the recommendation of the City of Vineland Electric Utility with respect to this request, along with a copy of the drawing identifying the area in question, is attached for your review.

Should you have any questions pertaining to this matter, please do not hesitate to contact this office.

Respectfully submitted,

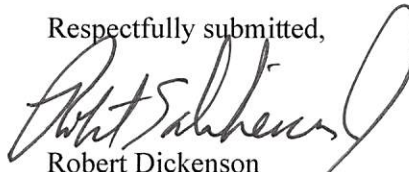

Robert Dickenson
Assistant Business Administrator

/rl

Encls.

cc: Joseph Isabella
Jackie Muccirelli

Approved:



Mayor

Date

CITY OF VINELAND

STREET LIGHTING RECOMMENDATION

April 2016

REQUEST

1. City Parking - East Ave and Wood St
Drawing No. VMEU-2830

RECOMMENDATION

Remove existing 250W HPS floodlight and install three (3) new 70W LED cobra head street lights on newly installed 35 ft. utility poles. (Requested by the Vineland Police Department)

MEMORANDUM

March 15, 2016



TO: ROBERT E. DICKENSON, JR.
ASSISTANT BUSINESS ADMINISTRATOR

FROM: JOSEPH A. ISABELLA
DIRECTOR OF MUNICIPAL UTILITIES

A handwritten signature in blue ink, appearing to be "J. Isabella", written over the "FROM:" line.

SUBJECT: STREET LIGHT SURVEY

The area mentioned below has been investigated for the possibility of installing additional street lights or for the possibility of upgrading existing street lights:

Name: John T. Boyle, Jr.
Address: City Parking
East Avenue & Wood Street
Vineland, NJ 08360
Telephone: 856-794-4000, Ext. 4295

The following has been recommended by the Vineland Municipal Electric Utility:

Remove existing 250W HPS floodlight and install three (3) new 70W LED cobra head street lights on newly installed 35 ft. utility poles. (Requested by the Vineland Police Department.)


This recommendation is illustrated on the Vineland Municipal Electric Utility Drawing No. VMEU-2830 which is attached.

JAI:djb

Attachments

VINELAND MUNICIPAL UTILITIES (VMU)
VINELAND, NEW JERSEY 08360

STREET LIGHT PROPOSAL



DATE: March 14, 2016

TO: John T. Boyle, Jr.

RE: Survey at : City Parking
(East Ave. & Wood St.)

PROPOSED BY:

NAME: John Boyle

ADDRESS: VMU

The preceding mentioned location has been surveyed by VMU to ensure proper street lighting in conformance with standard City practice. As a result, we propose the following enhancement(s):

Proposed: Remove existing 250W HPS floodlight and install (3) three new 70w LED

cobra head street lights on newly installed 35 ft utility poles.

Requested by V.P.D.

Yours truly,

A handwritten signature in black ink, appearing to read "John T. Boyle, Jr." with a stylized flourish at the end.

Attachments: DWG.#VMEU-2830


Approved by :

John T. Boyle, Jr.
Assist. General Manager
Vineland Municiple Utilities






NOTES:

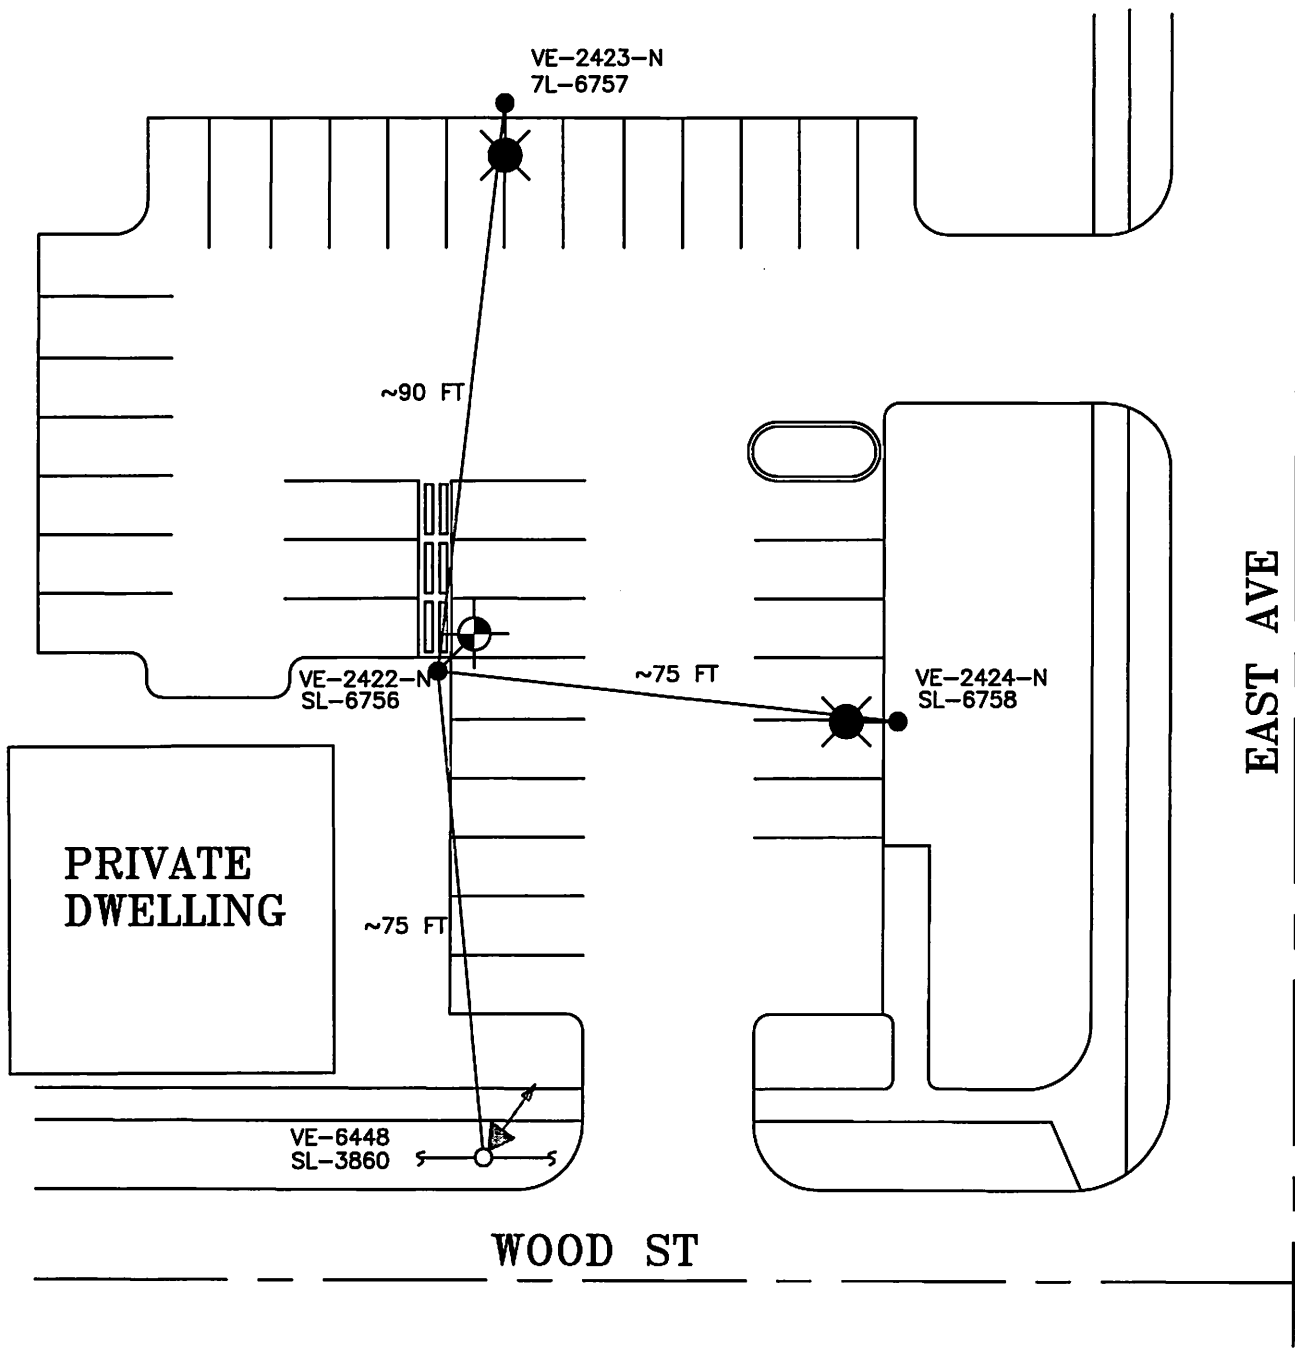- 1) SET 35' POLE 3' BEHIND CURB (3-LOCATIONS).
- 2) RUN #6 DPLX TO FEED NEW LIGHTS.
- 3) REMOVE 250W HPS FL LT SL-3860 AT VE-6448.
- 4) TREE TRIMMING REQ'D.



KEY:

-  INSTALL 70W R3 LED ST. LT (2)
-  INSTALL 70W R5 LED ST. LT (1)
INSTALL HOUSE GLARE SHIELD.
-  EXISTING FLOODLIGHT TO BE REMOVED.

PROPOSED LIGHTING REVISION, CITY PARKING, EAST AVE & WOOD ST	
VINELAND MUNICIPAL ELECTRIC UTILITY VINELAND, NEW JERSEY	
DATE: 03/14/16	SCALE: NONE
DRAWN: BL	JOB # 16-902
ENGINEER: JTB	VAULT # 103-271
APPROVED:	DRAWING # VMEU-2830