

CITY OF VINELAND

June 18, 2019

REPORT TO: THE MAYOR AND COUNCIL


**RE: Street Lighting Recommendation
June 2019**

Dear Mayor and Members of Council:

Submitted to you herewith are requests for installation of street lighting, which are ready for your approval. Copy of the recommendations from the Vineland Municipal Electric Utility with respect to the requests, along with copies of the drawings identifying the areas in question, are attached for your review

Should you have any questions pertaining to this matter, please do not hesitate to contact this office.

Respectfully submitted,




Robert E. Dickenson, Jr.
Business Administrator

/rl
Encls.

cc: John Lillie
Susan Baldosaro

Approved:

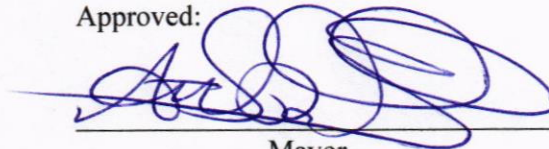

Mayor

6/13/2019

Date

CITY OF VINELAND

STREET LIGHTING RECOMMENDATIONS

JUNE 2019

REQUEST

RECOMMENDATIONS


- | | |
|--|---|
| 1. Area of Orchard Road
(between Elm Rd & Sherman Ave)
Drawing No. VMEU-2868 | Install fifteen (15) additional 74W LED on existing utility poles, relocating four (4) existing lights.
Installing three (3) 108W LED on existing utility poles. |
| 2. Area of Landis Avenue
(between Rte 55 and Orchard Rd)
Drawing No. VMEU-2869 | Install eleven (11) 165W LED on existing utility poles.
Replace eleven (11) 250W HPS with 165W LED. |

VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY 08360



STREET LIGHT REQUEST

DATE: May 30, 2019

TO: Bob Dickenson 
Business Administrator

RE: Survey at : Area of Orchard Rd.
btwn Elm Rd and Sherman Rd

PROPOSED BY:

NAME: John T. Boyle


ADDRESS: VMU

The preceding-mentioned location has been surveyed by VMU to ensure proper street lighting in conformance with standard City practice. As a result, we propose the following enhancement(s):



PROPOSED: Install fifteen (15) additional 74W LED on existing utility poles, relocating four (4) existing lights. Installing three (3) 108W LED on existing utility poles.

Yours truly,

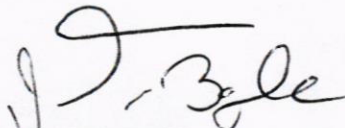

Approved by :


John T. Boyle, Jr.
Assistant General Manager
Vineland Municipal Utilities

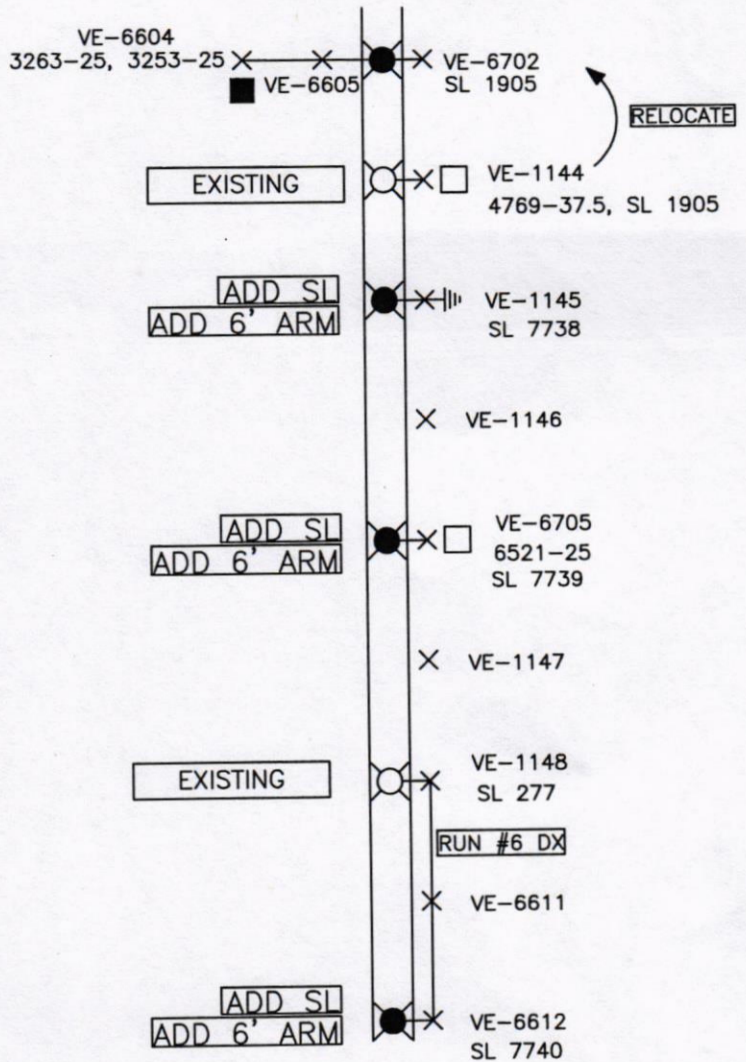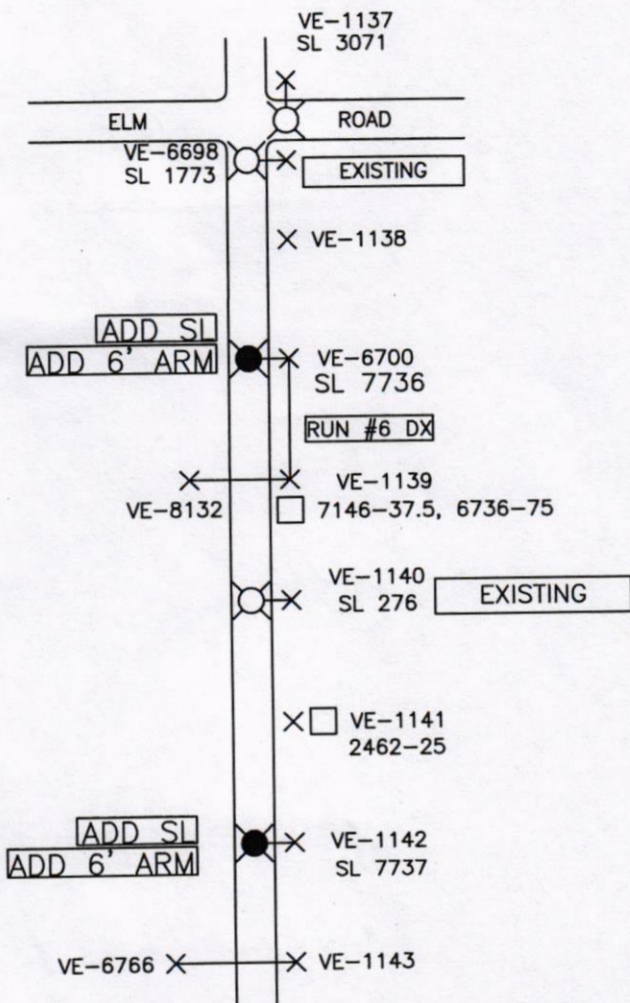Attachments: DWG.#VMEU-2868



KEY:

-  EXISTING LIGHT REMAIN AS IS
-  INSTALL/REPLACE 74W LED (6)

PROPOSED STREET LIGHT REVISION
AREA OF ORCHARD RD BETWEEN ELM RD AND SHERMAN AVE

VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY


DRAWN: NJF


DATE: 5/30/2019

SCALE: NTS

VAULT # F-3-C


DRAWING # VMEU-2868
(19-100-BL)

CHECKED: 

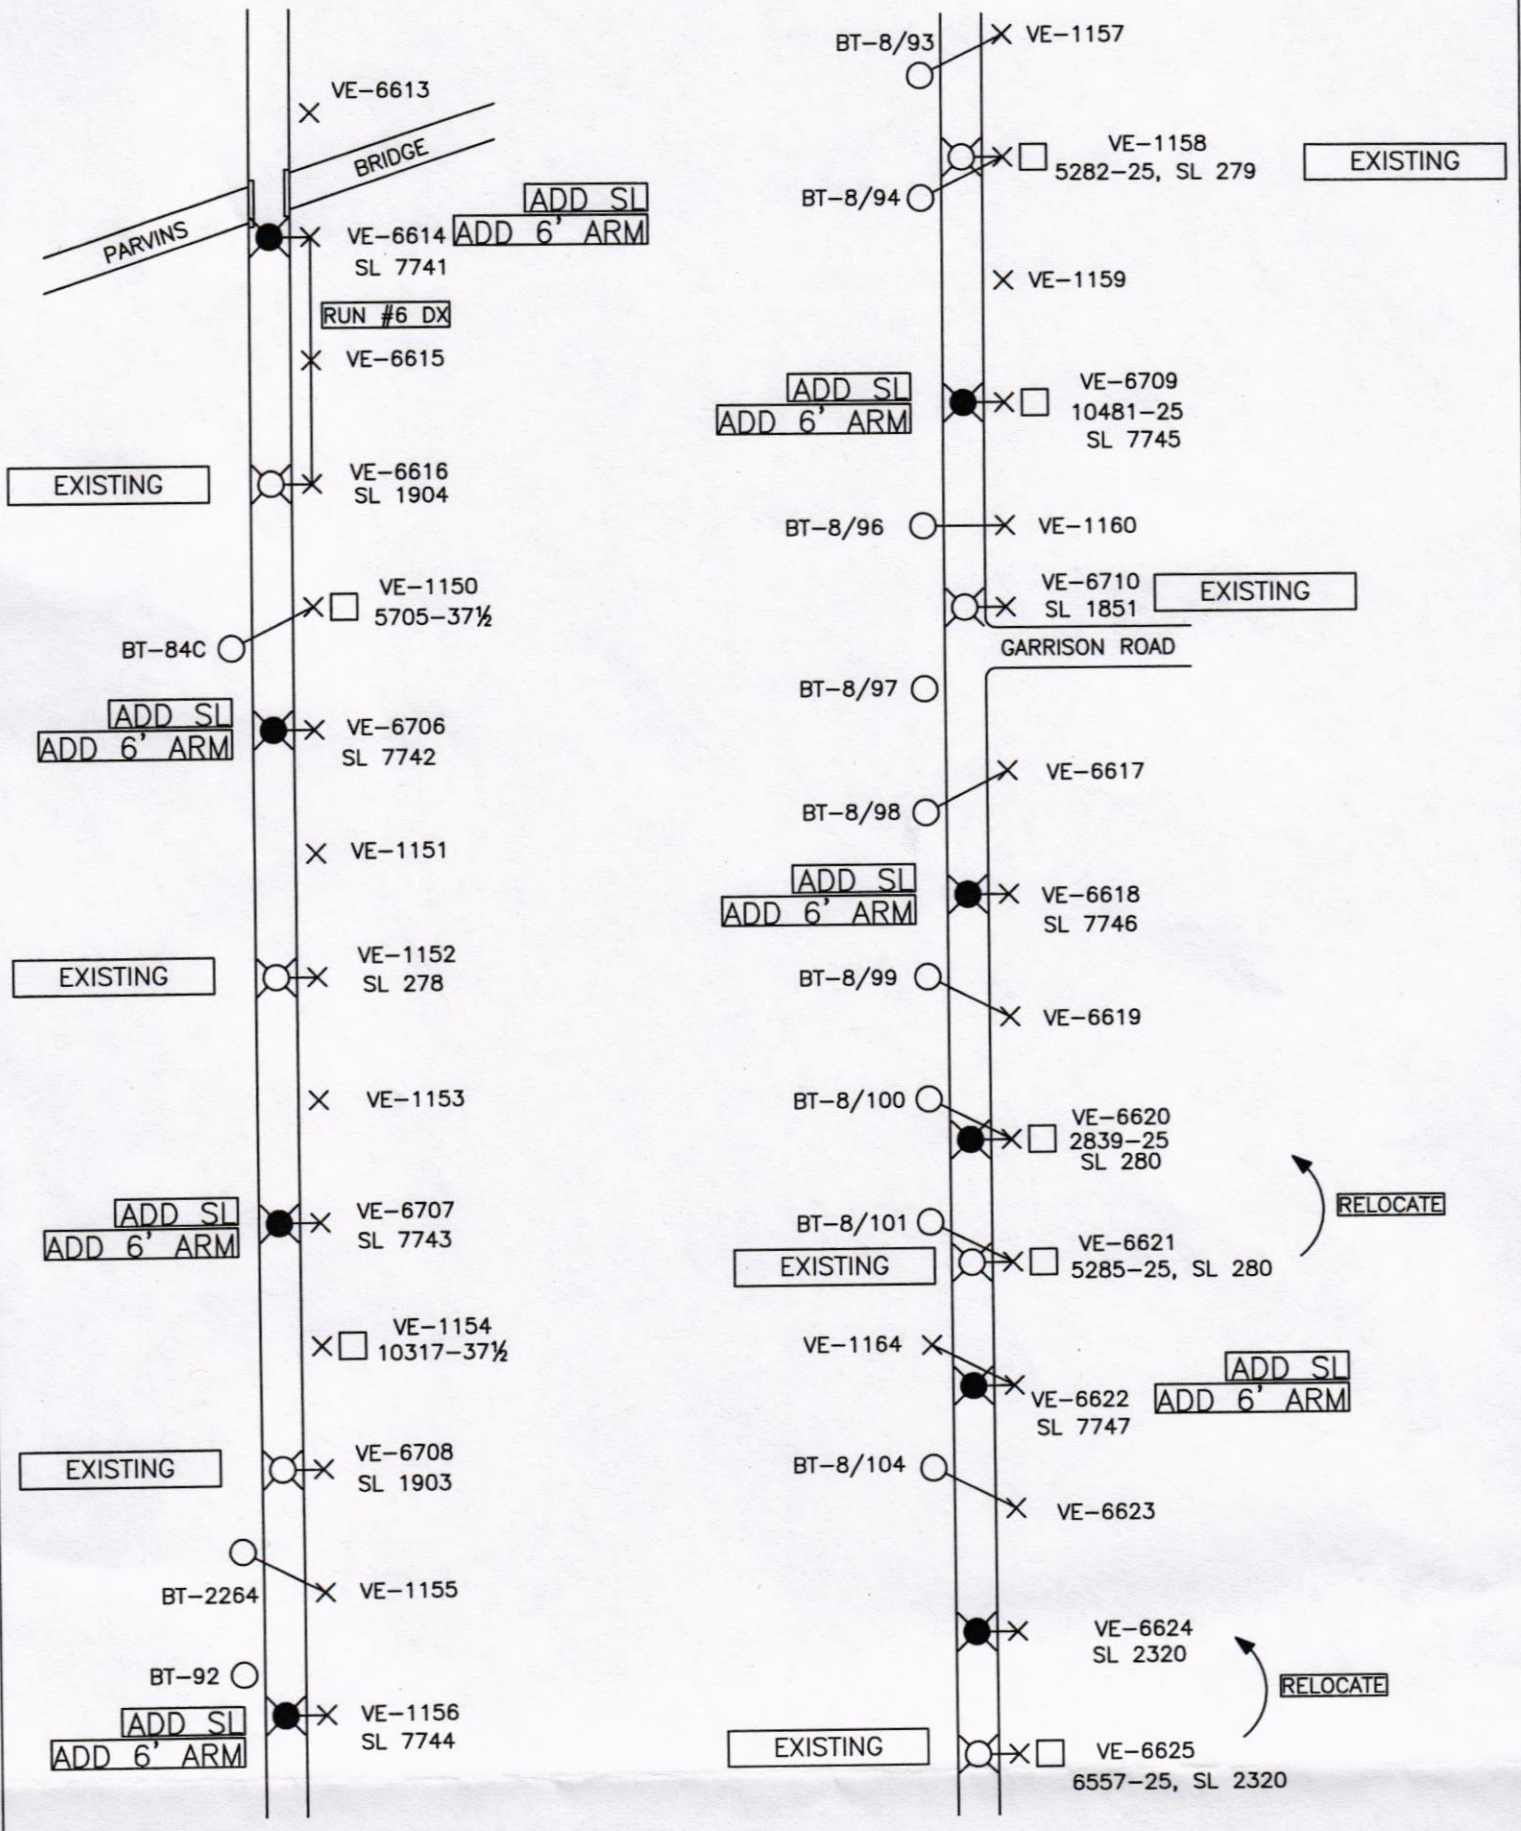

KEY:
 EXISTING LIGHT REMAIN AS IS
 INSTALL/REPLACE 74W LED (9)

PROPOSED STREET LIGHT REVISION AREA OF ORCHARD RD BETWEEN ELM RD AND SHERMAN AVE	
VINELAND MUNICIPAL ELECTRIC UTILITY VINELAND, NEW JERSEY	
DRAWN: NJF	VAULT # F-3-C
DATE: 5/30/2019	DRAWING # VMEU-2868 (19-100-BL)
SCALE: NTS	CHECKED:

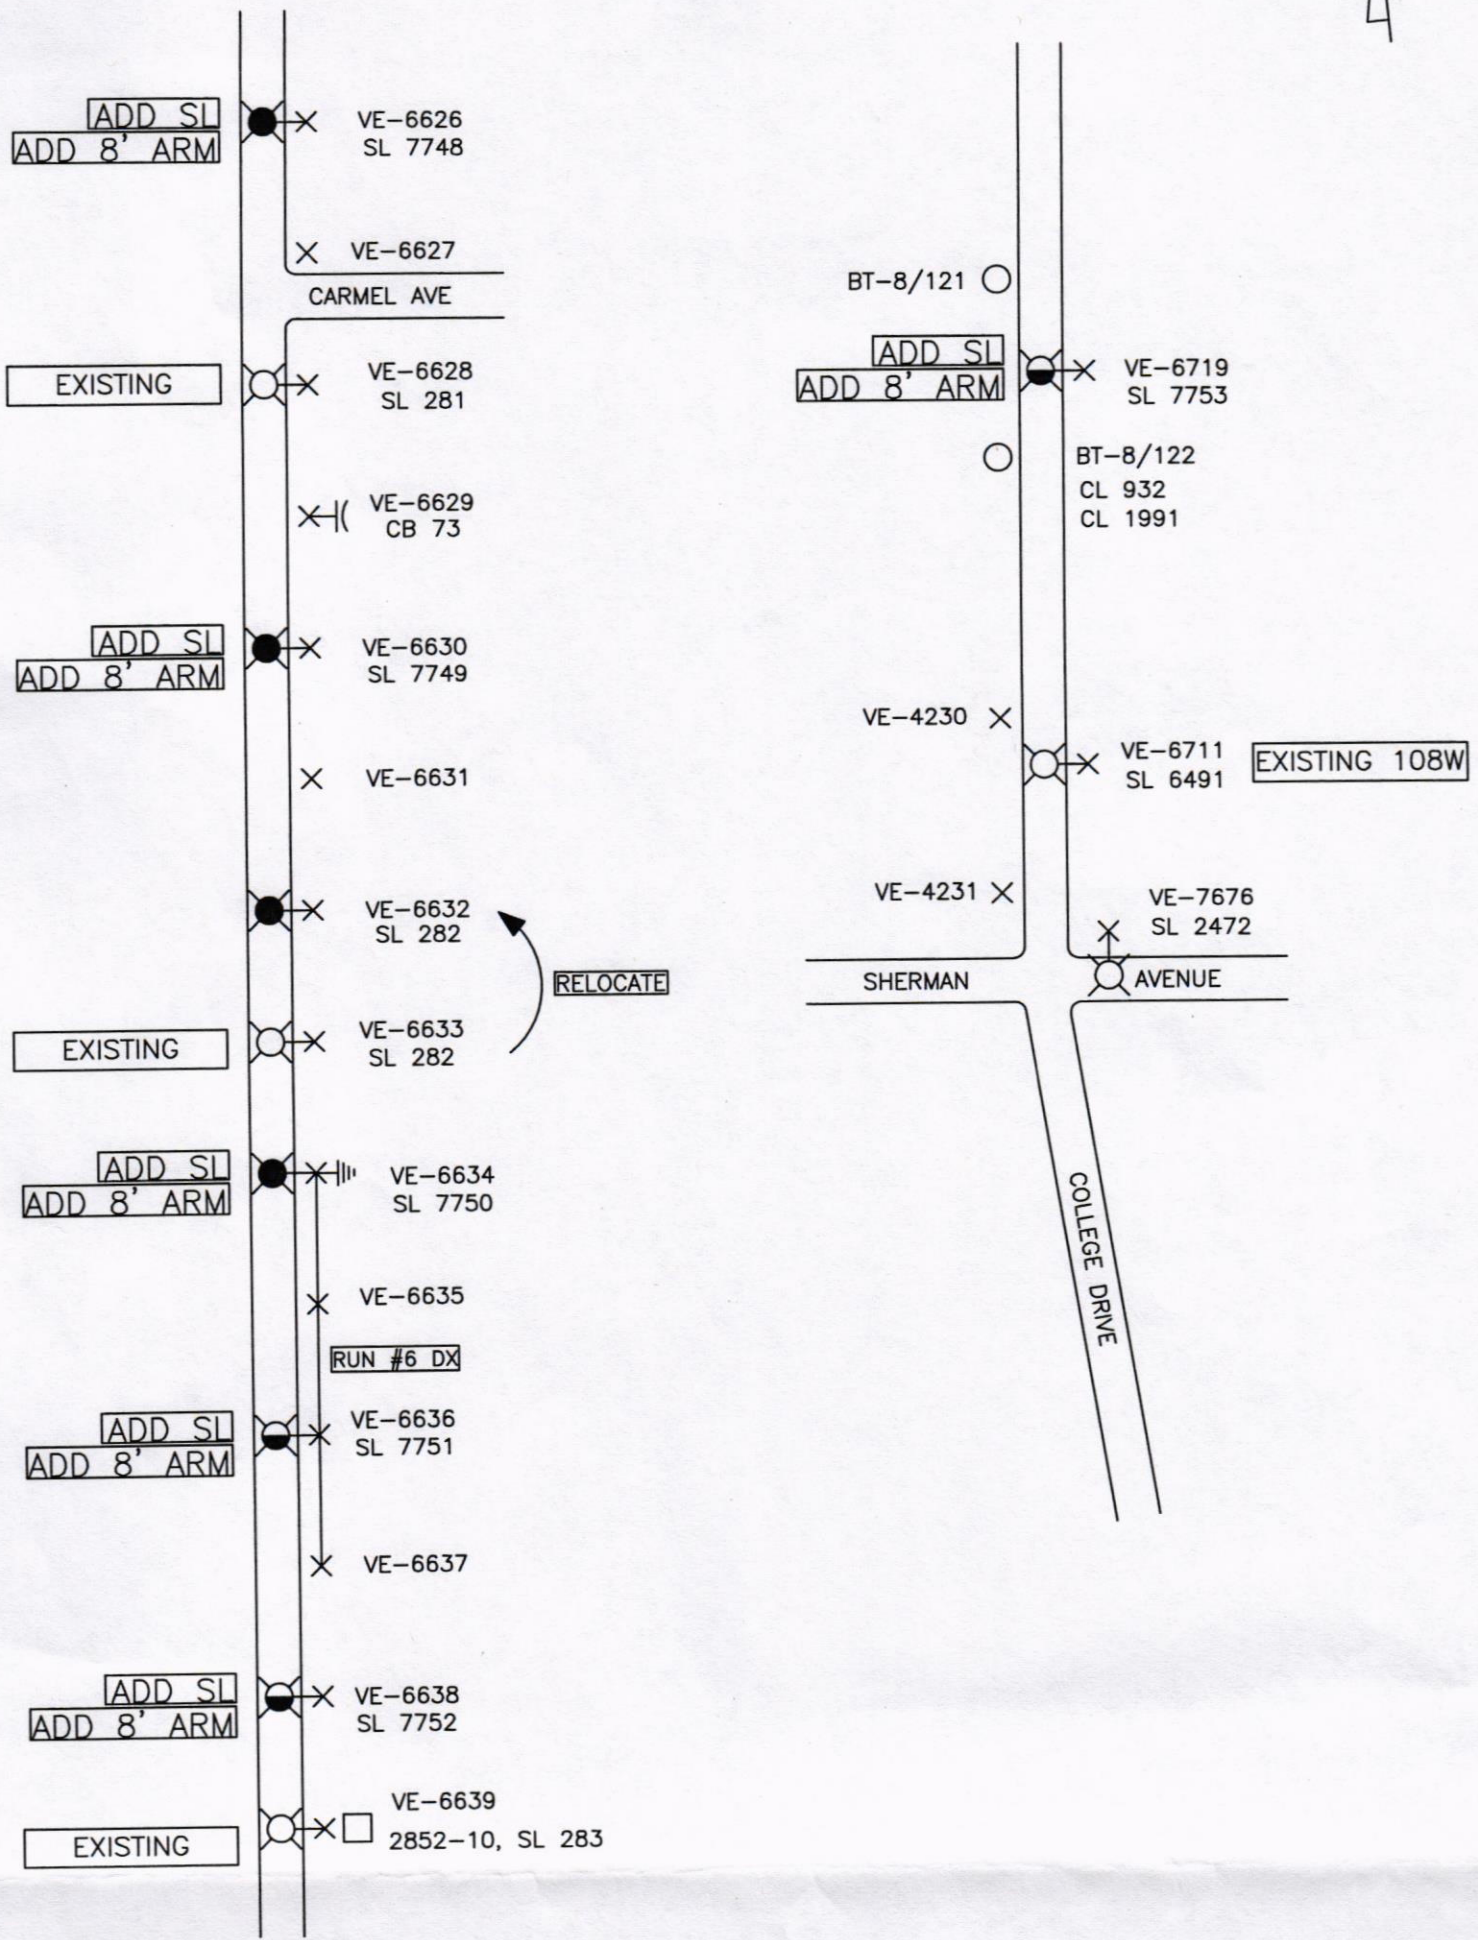

KEY:	
	EXISTING LIGHT REMAIN AS IS
	INSTALL/REPLACE 74W LED (4)
	INSTALL/REPLACE 108W LED (3)


PROPOSED STREET LIGHT REVISION AREA OF ORCHARD RD BETWEEN ELM RD AND SHERMAN AVE	
VINELAND MUNICIPAL ELECTRIC UTILITY VINELAND, NEW JERSEY	
DRAWN: NJF	VAULT # F-3-C
DATE: 5/30/2019	DRAWING # VMEU-2868 (19-100-BL)
SCALE: NTS	CHECKED:

VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY 08360



STREET LIGHT REQUEST

DATE: May 31, 2019

TO: Bob Dickenson 
Business Administrator

PROPOSED BY:

RE: Survey at : Area of Landis Ave
btwn Route 55 and Orchard Rd


NAME: John T. Boyle

ADDRESS: VMU

The preceding-mentioned location has been surveyed by VMU to ensure proper street lighting in conformance with standard City practice. As a result, we propose the following enhancement(s):

PROPOSED: Install eleven (11) 165W LED on existing utility poles. Replace eleven (11) 250W HPS with 165W LED.


Yours truly,

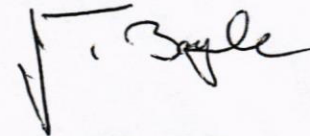

Approved by :

John T. Boyle, Jr.
Assistant General Manager
Vineland Municipal Utilities

Attachments: DWG.#VMEU-2869

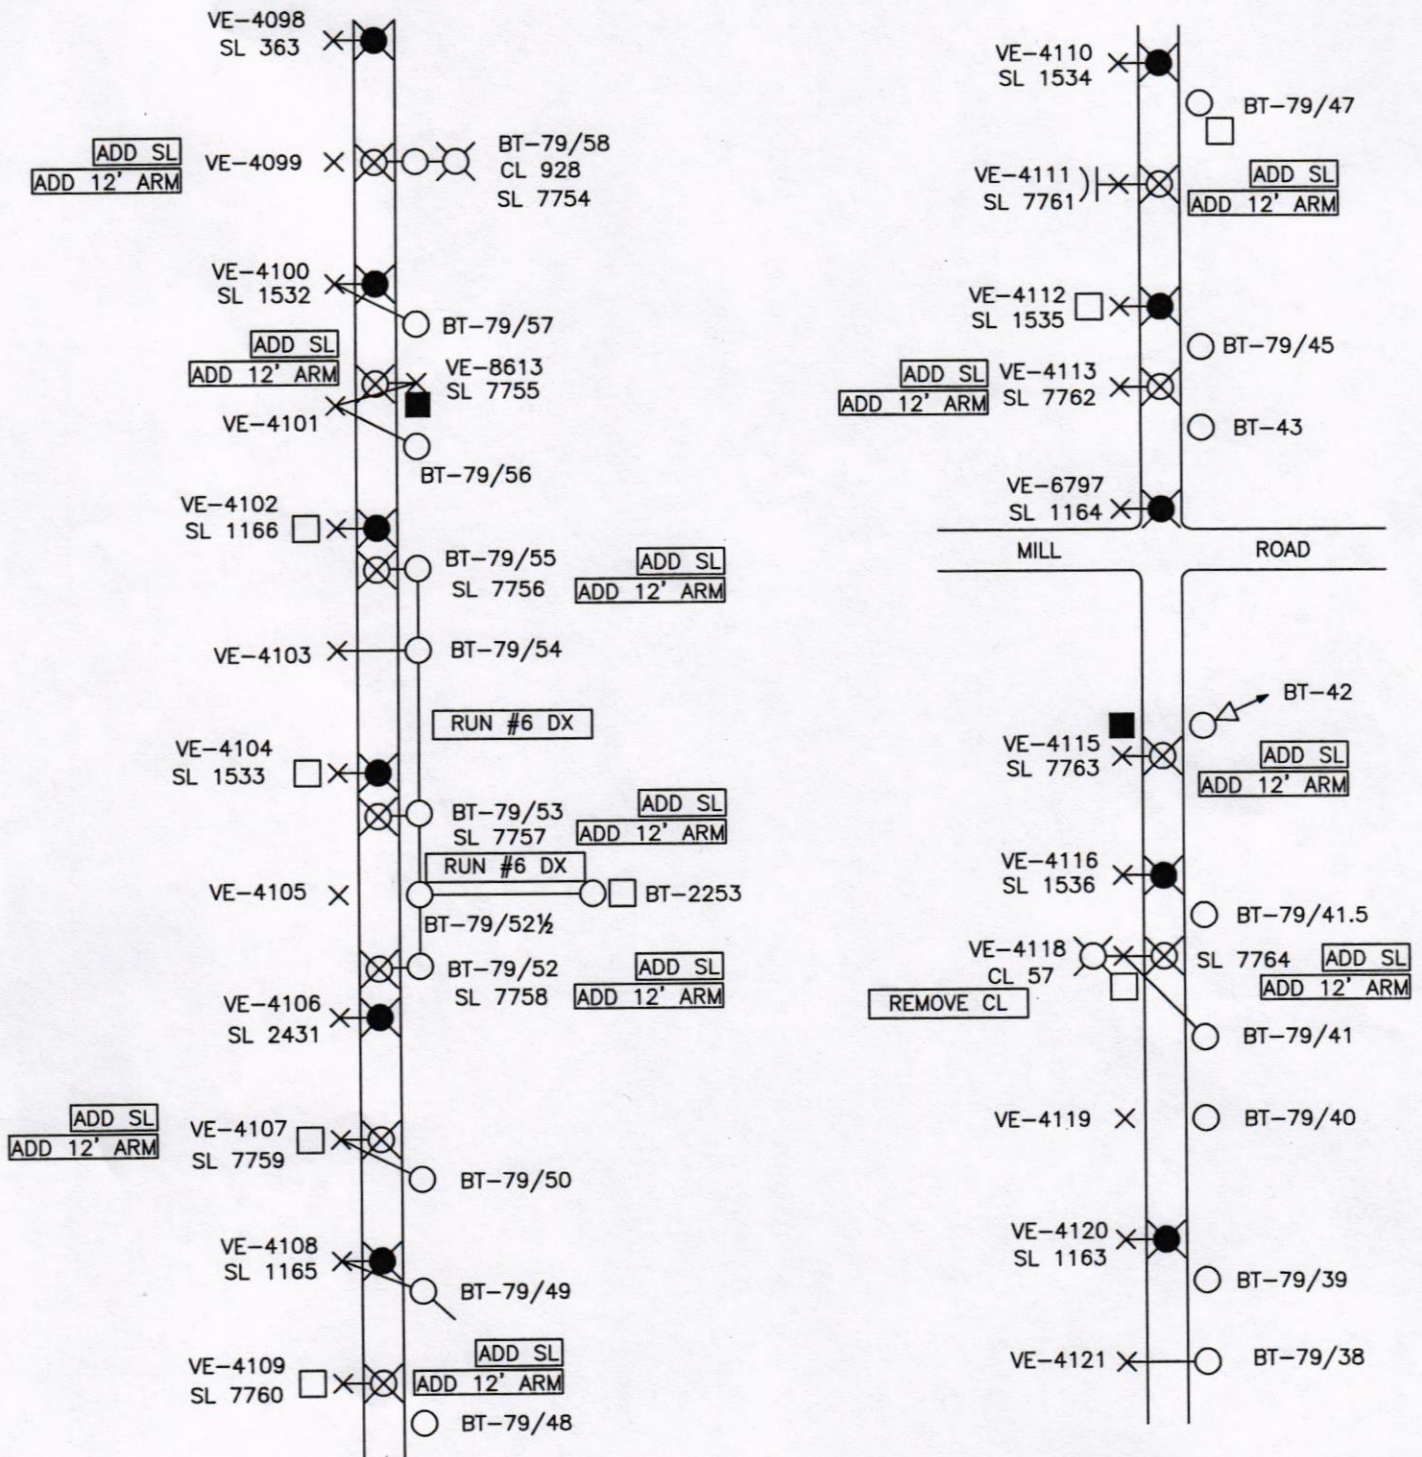

PROPOSED STREET LIGHT REVISION
AREA OF LANDIS AVE BETWEEN ROUTE 55 AND ORCHARD RD

VINELAND MUNICIPAL ELECTRIC UTILITY
VINELAND, NEW JERSEY

DRAWN: NJF

VAULT # F-3-C

DATE: 5/31/2019

DRAWING # VMEU-2869
(19-100-BM)

SCALE: NTS

CHECKED: *[Signature]*

KEY:	
	REPLACE WITH 165W LED (11)
	INSTALL 165W LED ON 12' BRACKET (11)